

UNIVERSITY OF KERALA

Thiruvananthapuram, Kerala, India – 695034

(Established as University of Travancore by the Travancore University Act in 1937 and reconstituted as University of Kerala by the Kerala University Act of 1957 and presently governed by the Kerala University Act of 1974 passed by the Kerala State Legislative Assembly)
(Re-accredited by NAAC with 'A⁺⁺' Grade)

15178/Admn B IV A/2023/UOK

01.07.2023

QUOTATION NOTICE (RE TENDER)

Competitive Quotations (Re-Tender) are invited from interested Vendors **within Kerala State**, for the supply of one number of Electrical Napkin Incinerator **for use in the University of Kerala Study Research Centre, Alappuzha**. The details of Specification for Electrical Napkin Incinerator and format of Compliance Statement are also appended.

Conditions

1. The rate quoted should be inclusive of Tax, transportation charges, installation charges and any other charges.
2. **Compliance Statement should be submitted that includes all parameters as in specification.**
3. Complaints if any with the items supplied should be rectified/replaced to the satisfaction of the University by the suppliers at their own cost.
4. **The item should be delivered and installed at University of Kerala Study Research Centre, Alappuzha.**
5. Payment will be made only after the supply of the items at our own site.
6. The undersigned reserves the right to accept/reject any quotation without assigning any reason.

The sealed quotations (re-tender) should be addressed to "The Registrar, University of Kerala, Senate House Campus, Palayam, Thiruvananthapuram - 695034", superscribing as "Quotations (re-tender) for the supply of one number of Electrical Napkin Incinerator for use in the University of Kerala Study Research Centre, Alappuzha". The last date of receipt of quotations is at 3.00 PM on 12.07.2023. The quotations will be opened at 3.30 PM on the same day in the presence of vendors then present.

Prof. (Dr.) K S Anil Kumar
Registrar



Specification for Electrical Napkin Incinerator


| | |
|--|--|
| Type | Wall Mountable |
| Operation Mode | Electronically operated, fully automatic |
| Loading Type | Front loading |
| Number of chambers | 2 |
| Residue Ash per Napkin | <1.5 gram |
| Trap Door | Required |
| Material of Thermal Insulation | High Density Ceramic fiber |
| Temperature indicator | Required |
| Timer | Required |
| Auto cut-off temperature display | Required |
| Minimum Burning temperature (degree C) | 800 |
| Burning Chamber tray | Required |
| Burning Capacity per day(Number of Napkins) | 40 - 50 Nos |
| Power supply | 230V +/-10%, 50Hz, Single phase AC Supply |
| Type of Heater | Ceramic heater containing coil |
| Type of SCU (Smoke Control Unit) | Top mounted with minimum 3M length of flexible emission outlet PCB |
| Safety MCB | Required |
| Pollution Certificate from Central/State Pollution control boards /CSIR/NABL | Required |

Format of Compliance Statement

| Feature | Description | Compliance (Yes/No) | Remarks |
|----------------------------------|--|---------------------|---------|
| Type | Wall Mountable | | |
| Operation Mode | Electronically operated, fully automatic | | |
| Loading Type | Front loading | | |
| Number of chambers | 2 | | |
| Residue Ash per Napkin | <1.5 gram | | |
| Trap Door | Required | | |
| Material of Thermal Insulation | High Density Ceramic fiber | | |
| Temperature indicator | Required | | |
| Timer | Required | | |
| Auto cut-off temperature display | Required | | |



| | | | |
|--|---|--|--|
| Minimum Burning temperature (degree C) | 800 | | |
| Burning Chamber tray | Required | | |
| Burning Capacity per day (Number of Napkins) | 40 - 50 Nos | | |
| Power supply | 230V +/-10%, 50Hz, Single phase AC Supply | | |
| Type of Heater | Ceramic heater containing coil | | |
| Type of SCU (Smoke Control Unit) | Top mounted with minimum 3M length of flexible emission outlet PCB | | |
| Safety MCB | Required | | |
| Pollution Certificate from Central/State Pollution control boards /CSIR/NABL | Required | | |
| Warranty | One-year comprehensive warranty | | |

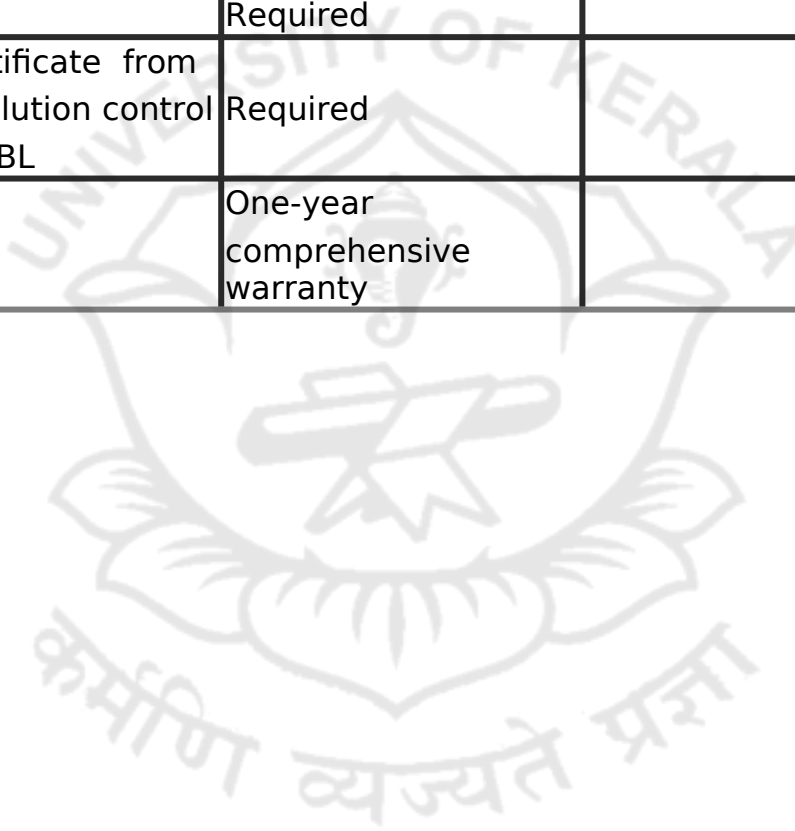

Prof. (Dr.) K S Anil Kumar

Registrar

